


Project:
20100624 wysoka_raport.

Description:
WARIANT I

(rozplanowanie 20szt.)
turbina N90 LS 2,5MW;
D=90m; h=100m;

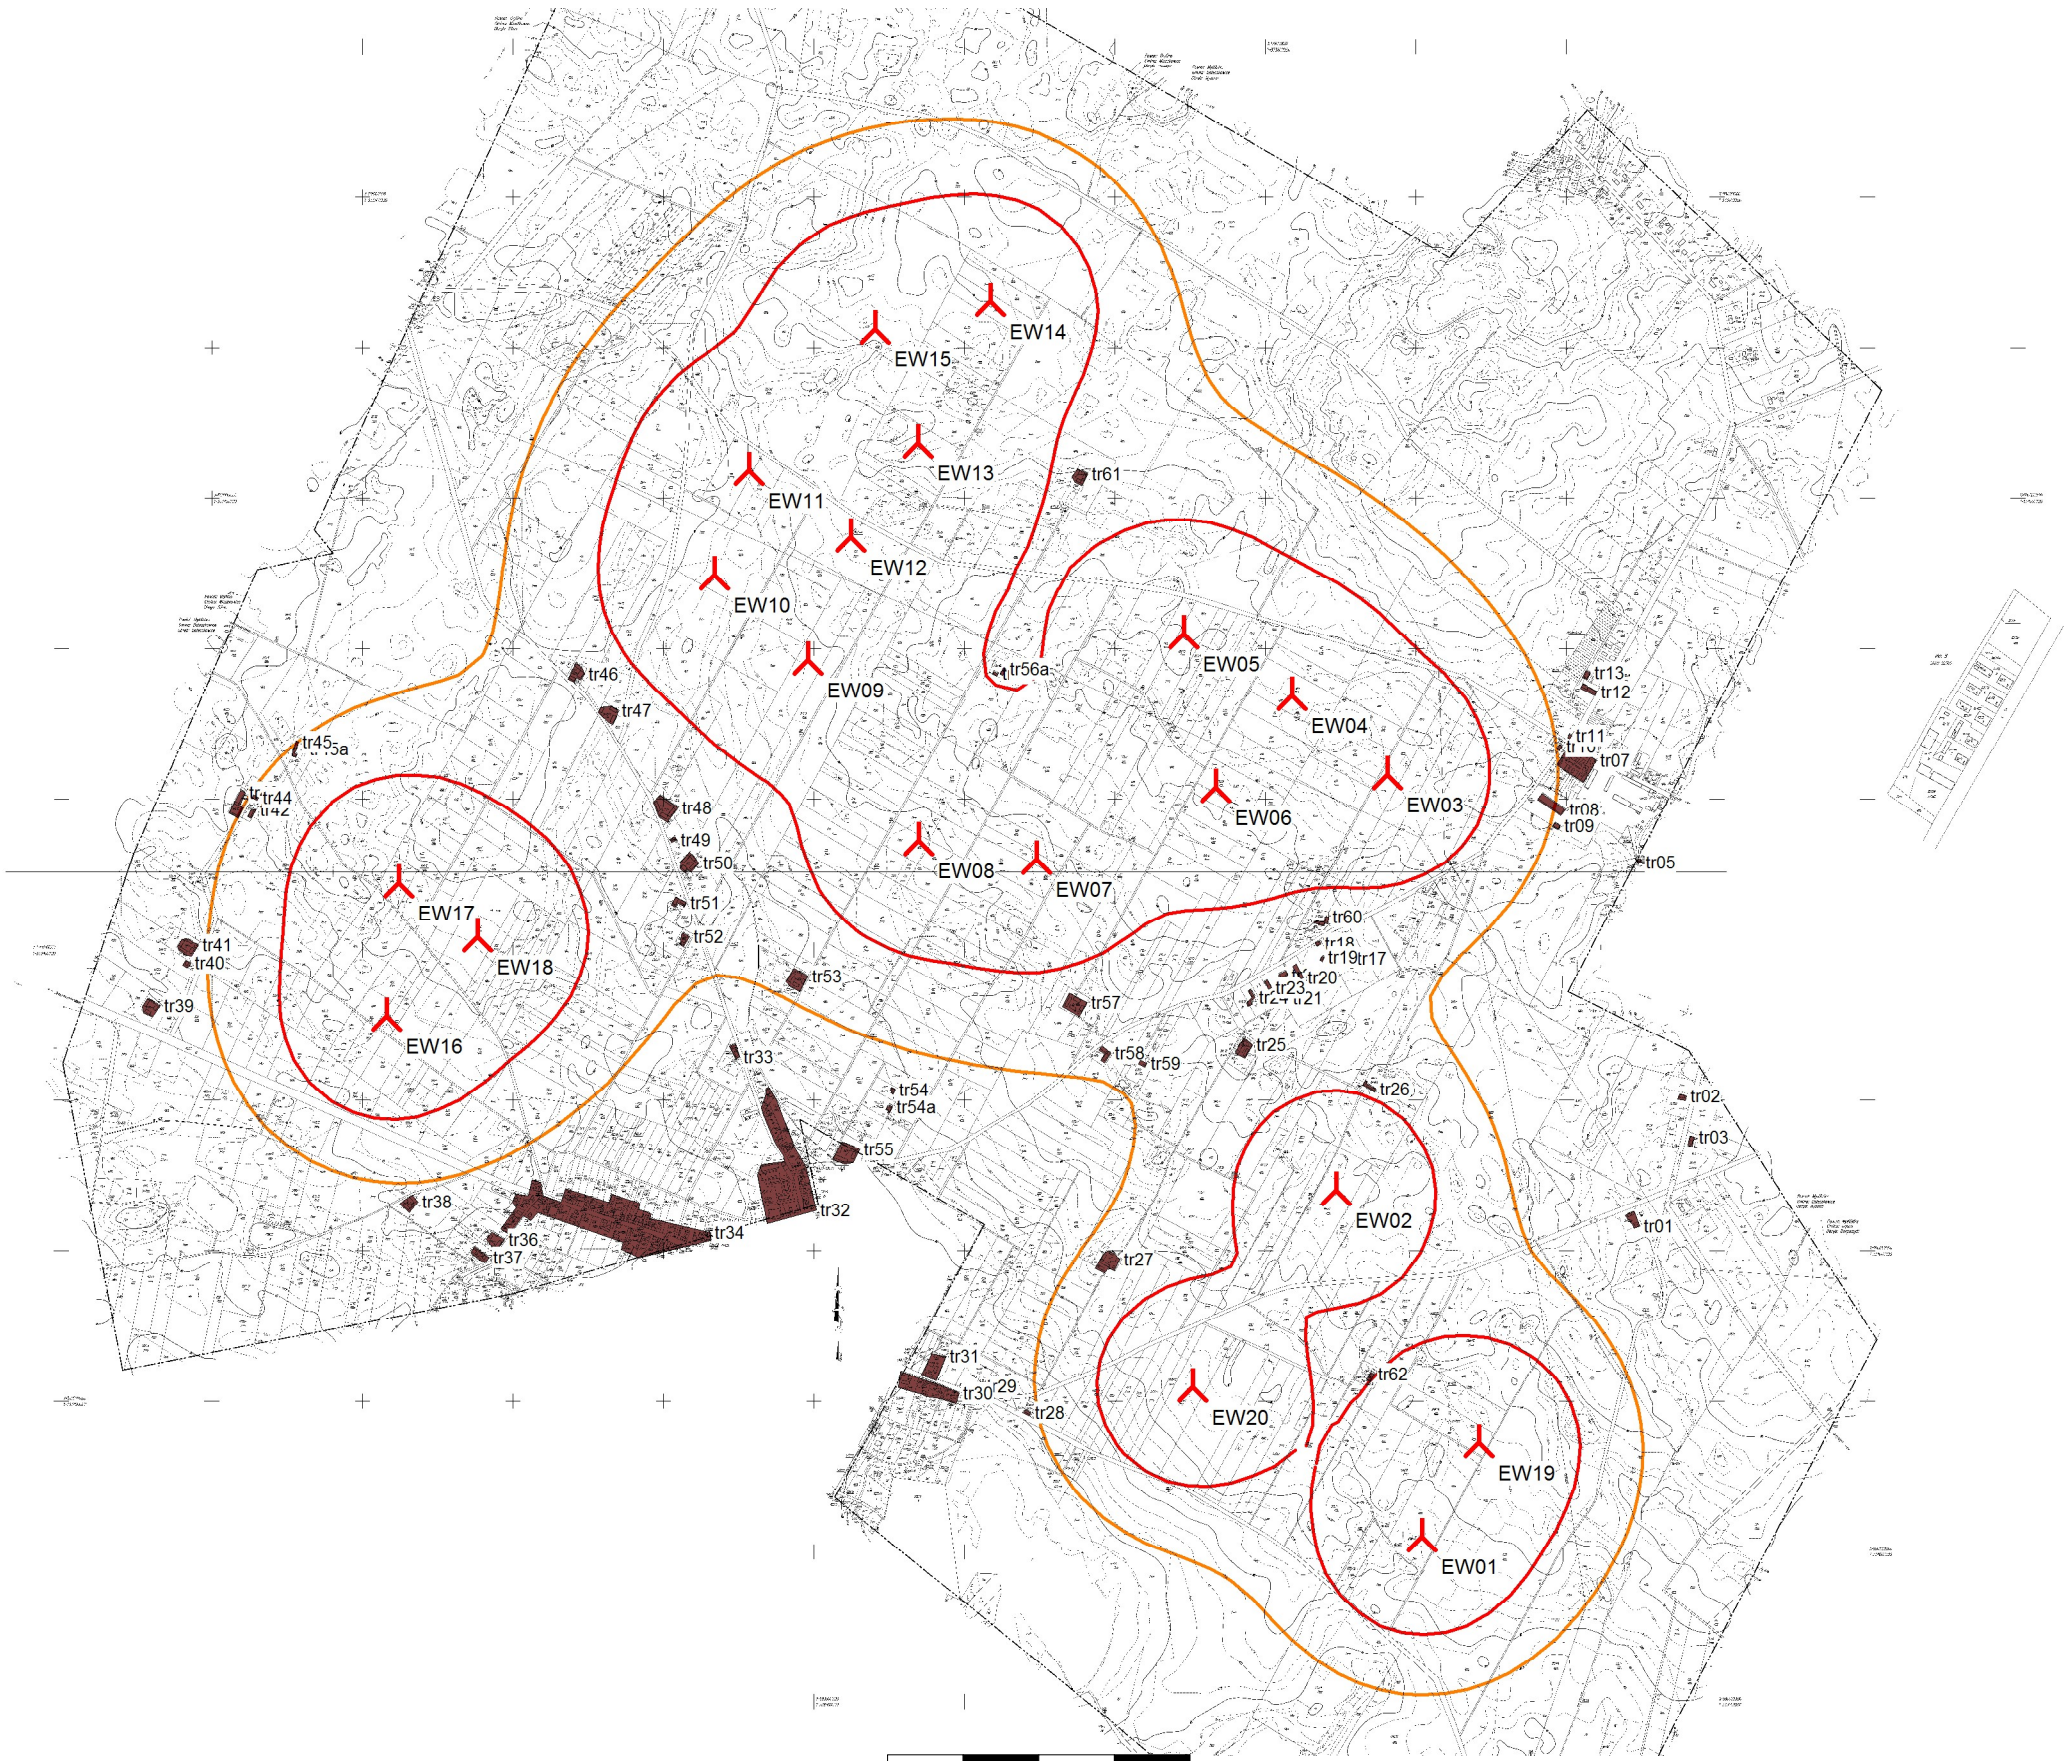

New WTG
Noise sensitive area
45,0 dB(A)
40,0 dB(A)

Map: , Print scale 1:25 000, Map center Poland UKLAD 65 3 East: 3 337 146 North: 5 907 626
Noise calculation model: ISO 9613-2 General. Wind speed: 10,0 m/s
Height above sea level: 67,0 m

DECIBEL -
Map 10,0 m/s
Calculation:
WARIANT I N90 LS

Printed/Page
2010-06-25 11:43 / 1
Licensed user:
RENPRO Sp. z o.o.
Ul. Panienska 18/3
PL-70-535 Szczecin
+48 091 8121532
Hanna Michalak / hm@renpro.pl
Calculated:
2010-06-25 11:40/2.7.468